

BOARD APPROVED


Case No: 2011-0514

Date: 10-17-11

W/Conditions: X

W/Out Conditions:

VILLAGE OF ORLAND PARK

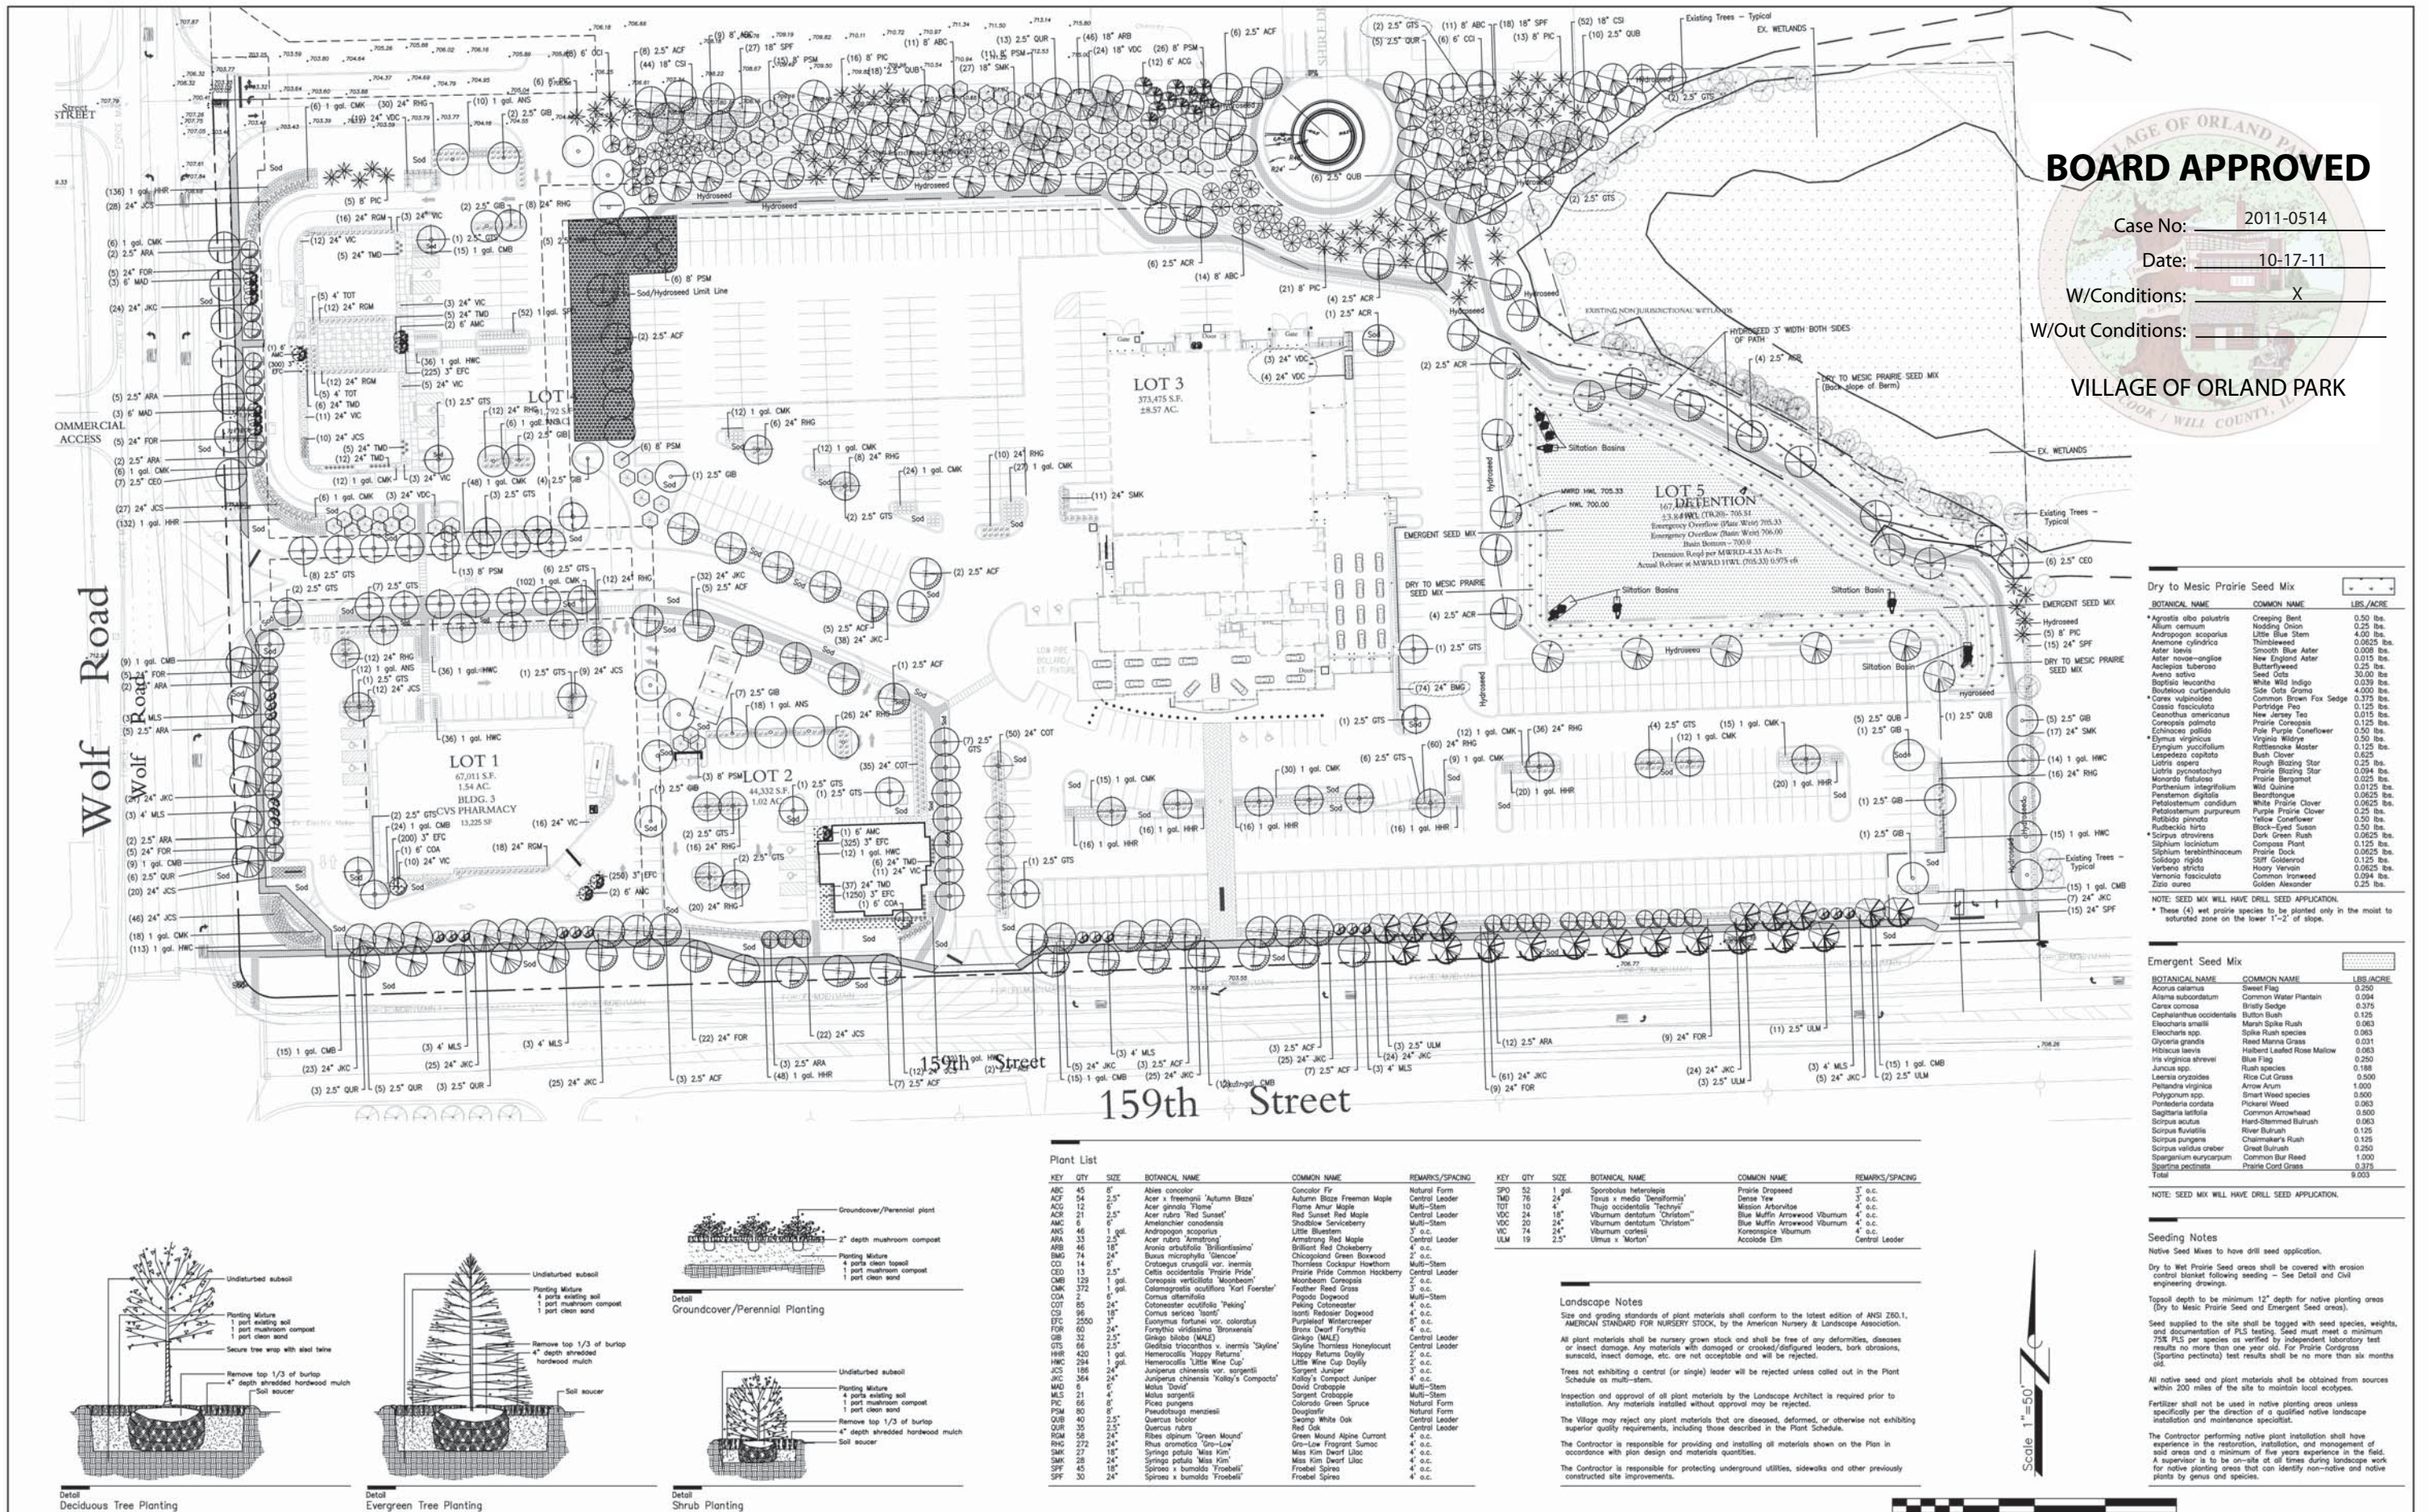

Plant List

KEY	QTY	SIZE	BOTANICAL NAME	COMMON NAME	REMARKS/SPACING
ABC	45	8"	Abies concolor	Concolor Fir	Natural Form
ACF	54	2.5"	Acer x freemanii 'Autumn Blaze'	Autumn Blaze Freeman Maple	Central Leader
ACG	12	6"	Acer ginnala 'Flame'	Flame Amur Maple	Multi-Stem
ACR	21	2.5"	Acer rubra 'Red Sunset'	Red Sunset Red Maple	Central Leader
AMC	6	6"	Amelanchier canadensis	Shadblow Serviceberry	Multi-Stem
AND	46	1 gal.	Andropogon scoparius	Little Bluestem	3' o.c.
ARA	33	2.5"	Acer rubra 'Armstrong'	Armstrong Red Maple	Central Leader
ARB	46	18"	Aronia arbutifolia 'Brilliantissima'	Brilliant Red Chokeberry	4' o.c.
BAG	74	24"	Buxus microphylla 'Glennbrook'	Glennbrook Green Boxwood	2' o.c.
COI	14	6"	Crataegus crugata var. inermis	Thornless Cockspur Hawthorn	Multi-Stem
CEJ	14	6"	Celtis occidentalis 'Purpurea'	Purple-leafed Hackberry	Central Leader
CMB	129	1 gal.	Coronilla verticillata 'Moonbeam'	Moonbeam Coronilla	2' o.c.
CMK	372	1 gal.	Colonygrassia acutiflora 'Karl Foerster'	Feather Reed Grass	3' o.c.
COA	46	6"	Cornus alternifolia	Pagoda Dogwood	Multi-Stem
COT	85	24"	Cotoneaster acutifolia 'Peeking'	Peeking Cotoneaster	4' o.c.
CS	96	18"	Cornus sericea 'Ivory'	Ivory Dogwood	4' o.c.
EFC	2500	3"	Eurytemora fortunei var. coloratus	Purple-leafed Wintercreeper	6' o.c.
BAG	60	24"	Buxus microphylla 'Glennbrook'	Glennbrook Green Boxwood	2' o.c.
FOR	60	24"	Forsythia viridissima 'Vermilion'	Vermilion Forsythia	Central Leader
GTS	66	2.5"	Gleditsia triacanthos v. inermis 'Skyline'	Skyline Thornless Honeylocust	Central Leader
HWC	420	1 gal.	Hemerocallis 'Happy Returns'	Happy Returns Daylily	2' o.c.
JCS	188	24"	Juniperus chinensis var. sargentii	Little Blue Cypress	3' o.c.
JCS	364	24"	Juniperus chinensis var. sargentii	Sargent Juniper	3' o.c.
MAD	6	6"	Malus 'David'	David Crabapple	Multi-Stem
MLS	21	6"	Malus sargentii	Sargent Crabapple	Multi-Stem
PC	80	8"	Picea pungens	Colorado Green Spruce	Natural Form
QUR	35	2.5"	Quercus bicolor	Swamp White Oak	Central Leader
QUR	35	2.5"	Quercus rubra	Red Oak	Central Leader
RGH	58	24"	Ribes alpinum 'Green Mound'	Green Mound Alpine Currant	4' o.c.
RHS	272	24"	Rhus aromatica 'Crisp-Leaf'	Crisp-Leaf Fragrant Sumac	4' o.c.
SMK	27	18"	Syringa potted 'Miss Kim'	Miss Kim Dwarf Lilac	4' o.c.
SPF	28	24"	Spiraea x bumalda 'Miss Kim'	Miss Kim Dwarf Lilac	4' o.c.
SPF	45	18"	Spiraea x bumalda 'Frederick'	Frederick Dwarf Lilac	4' o.c.
SPF	30	24"	Spiraea x bumalda 'Frederick'	Frederick Dwarf Lilac	4' o.c.

Landscape Notes

Size and grading standards of plant materials shall conform to the latest edition of ANSI Z60.1, AMERICAN STANDARD FOR NURSERY STOCK, by the American Nursery & Landscape Association.

All plant materials shall be nursery grown stock and shall be free of any deformities, diseases, or insect damage. Any materials with damaged or crooked/damaged leaders, bark abrasions, sunscald, insect damage, etc. are not acceptable and will be rejected.

Trees not exhibiting a central (or single) leader will be rejected unless called out in the Plant Schedule as multi-stem.

Inspection and approval of all plant materials by the Landscape Architect is required prior to installation. Any materials installed without approval may be rejected.

The Village may reject any plant materials that are diseased, deformed, or otherwise not exhibiting superior quality requirements, including those described in the Plant Schedule.

The Contractor is responsible for providing and installing all materials shown on the Plan in accordance with plan design and materials quantities.

The Contractor is responsible for protecting underground utilities, sidewalks and other previously constructed site improvements.

Seeding Notes

Native Seed Mixes to have drill seed application.

Dry to Mesic Prairie Seed areas shall be covered with erosion control blanket following seeding - See Detail and Civil engineering drawings.

Topsoil depth to be minimum 12" depth for native planting areas (Dry to Mesic Prairie Seed and Emergent Seed areas).

Seed supplied to the site shall be topped with seed species, weights, and documentation of PLS testing. Seed must meet a minimum 75% PLS per species as verified by independent laboratory test results no more than one year old. For Prairie Cordgrass (Spartina pectinata) test results shall be no more than six months old.

All native seed and plant materials shall be obtained from sources within 200 miles of the site to maintain local ecotypes.

Fertilizer shall not be used in native planting areas unless specifically per the direction of a qualified native landscape installation and maintenance specialist.

The Contractor performing native plant installation shall have experience in the restoration, installation, and management of seed areas and a minimum of five years experience in the field. A supervisor is to be on-site at all times during landscape work for native planting areas that can identify non-native and native plants by genus and species.

REVISIONS		
NO.	DATE	DESCRIPTION
4	11-04-09	Per Village Review (PRI) 10-30-09
3	09-23-09	
2	08-28-09	Per Village Review 5-21-09
1	4-20-09	PER VILLAGE REVIEW 4-03-09

LANDSCAPE PLAN

RETAIL DEVELOPMENT
NEC 159th STREET AND WOLF ROAD
ORLAND PARK, ILLINOIS

Craig R. Knoche & Associates
Civil Engineers, P.C.
24 N. Bennett Street • Geneva, IL 60134 • phone (630) 845-1270 • fax (630) 845-1275

DATE: 3-04-09
FILE: 4041-c40
JOB NO: 4-041
SHEET NO: C4.1