

DOOR & HARDWARE SCHEDULE

DOOR		FRAME				HARDWARE		SIGN		DTL.		NOTES
NO.	TYP.	SIZE	MAT.	FIN.	LOV.	MAT.	FIN.	TYP.	U.L.			
1&2	E2	3'-0"x6'-8"x1 3/4"	ST	PT	--	WD	PT	F2	--	H2,C,L,D,T,W,SF	--	12,4,5,8
3&4	E1	3'-0"x6'-8"x1 3/4"	ST	PT	--	WD	PT	F2	--	H2,C,L,D,T,W,SF	--	12,4,5,8
5	F	3'-0"x6'-8"x1 3/4"	WD	UF	--	HM	UF	F2	--	H2,L,V,SW	HC TOILET	3,8
6	F	3'-0"x6'-8"x1 3/4"	WD	UF	--	HM	UF	F2	B	H2,C,L,S,SW	MECHANICAL	7,8,9
7	F	3'-0"x6'-8"x1 3/4"	WD	UF	--	HM	UF	F2	--	H2,C,L,S,SW	--	8,9
8	P	3'-0"x6'-8"x1 3/4"	ST	PT	--	WD	PT	F2	--	H2,L,S,T,W,G,SF	MECHANICAL	2,4
9&10	PG	3'-0"x6'-8"x1 3/4"	ST	PT	--	WD	PT	F2	--	H2,C,L,D,T,W,SF	--	2,4,5,6,8
11&12	PG	3'-0"x6'-8"x1 3/4"	ST	PT	--	WD	PT	F2	--	H2,C,L,D,T,SW	--	2,4,5,6,8


ABBREVIATIONS:
HM HOLLOW METAL (F2 = 2" HEAD)
PT PAINT
ST STEEL
WD WOOD (SOLID CORE)
UF UNFINISHED

HARDWARE:
C CLOSER - HANDICAP
H HINGES (H2= 1 PR)
L LOCKSETS
D DEADBOLT W/ LEVER
S STORAGE
V PRIVACY
G CHAIN GUARD
S STOP
W = WALL, F= FLOOR
THRESHOLD WEATHERSTRIPPING

GENERAL NOTES:
1. EXIT DOORS SHALL BE KEYLESS LOCKSETS ON EGRESS SIDE/FLUSH BOLTS, DEADBOLTS OR DRAWBOLTS.
2. ALUMINUM THRESHOLD 1/2" MAX.
3. GLASS WITHIN 24" OF DOORS SHALL BE TEMPERED SAFETY GLASS

NOTES:
1. TEMPERED INSULATED GLASS SIDELIGHT.
2. INSULATED DOOR FLUSH BOLTS, DEADBOLTS OR DRAWBOLTS.
3. HANDICAP TOILET SYMBOL & WORDS W/ BRAILLE SYMBOLS.
4. EMBOSSED RAISED PANEL.
5. TENANT ADDRESS.
6. VIEWER WINDOW W/ TEMPERED GLASS.
7. UNDERCUT DOOR 1 1/2"
8. SEE PLAN FOR SWING
9. PROVIDE KNULED TEXTURED HANDLE

DOOR & FRAME TYPES

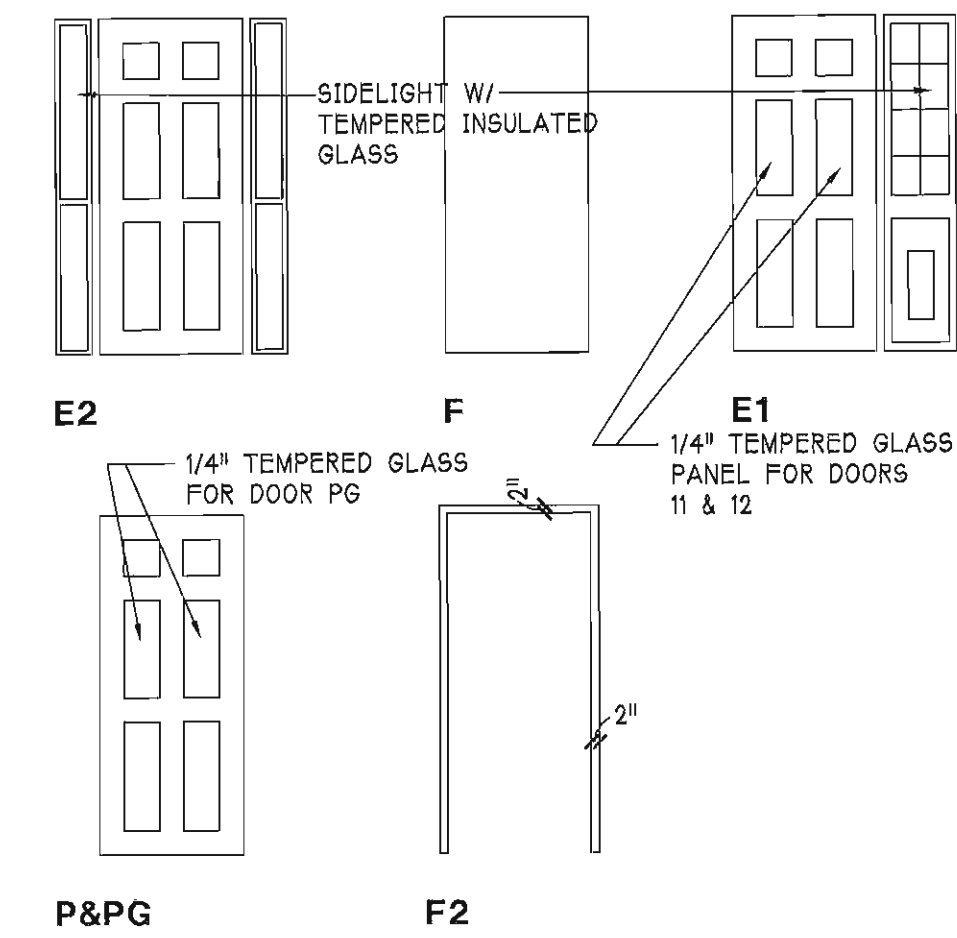

ROOM FINISH SCHEDULE


NO.	NAME	FLR.	FIN.	BASE	WALL-FIN.	CLG.-FIN.	HT.
--	UNITS 1-4	CO	SL	--	CM/UF	GB/UF	10'-4 1/2"
--	TOILET	CO	SL	--	GB/UF	GB/UF	10'-4 1/2"
--	MECHANICAL A	CO	SL	--	GB/CM/UF	GB/UF	10'-4 1/2"
--	MECHANICAL B	WD	RT	VB	GB/UF	GB/UF	8'-0 1/2"
--	STORAGE A	CO	SL	--	GB/CM/UF	GB/UF	10'-4 1/2"
--	PRIVATE OFFICE	CO	RT	VB	GB/UF	GB/UF	8'-0 1/2"
--	BUILDING MECH.	CO	SL	VB	CM/GB/UF	CM/GB/UF	10'-4 1/2"
--	VESTIBULE	CO	CT	CT	GB/PT	GB/PT	PITCHED

ABBREVIATIONS:
CO CONCRETE
CM CONCRETE MASONRY
CT CERAMIC TILE
GB GYPSUM BOARD
PT PAINT
SL SEALER
UF UNFINISHED
WD PLYWOOD ON WOOD FRAMING


NOTE:
1. UNIT FINISHES BY TENANT
2. CEILING HEIGHT NOTED TO BOTTOM OF GYP. BD CEILING ON FRAMING
3. GYP. BD. / WALL FURRING BY TENANT. SEE SCOPE OF WORK NOTE A7 SHEET A2

SCOPE OF WORK NOTES

- A1 TENANT DEMISING WALL (7'5" 11 HOUR FIRE RATED (S1M UL-U305); 11 LAYER 5/8" FIRE RATED GYP. BD. ON 2"x6" STUDS @ 16" O.C. W/6" SOUND INSULATION. (TO BOTTOM OF ROOF TRUSSES 10'-4") (OPTION: METAL STUDS - UL-U419)
- A2 EXTERIOR MASONRY WALL (12'5" 4" FACEBRICK/ CULTURED STONE W/ 8" CONCRETE MASONRY WALL W/ GALVANIZED HORIZONTAL WALL REINFORCING @ 16" O.C. PROVIDE VERTICAL WALL REINFORCING PER STRUCTURAL DRAWINGS. SEE NOTE A7 FOR FURRING BY TENANT & BUILDING SECTIONS A/A6 & B/A6. (4-HOUR FIRE RATED SIM TO UL-U902)
- A3 TENANT MECHANICAL ROOM WALL (5'5" 11 HOUR FIRE RATED WALL (UL-U305); 11 LAYER 5/8" FIRE RATED GYP. BD. ON 2"x4" STUDS @ 16" O.C. W/4" SOUND INSULATION. (TO BOTTOM OF ROOF TRUSSES 10'-4") (OPTION: METAL STUDS UL-U419)
- A4 TOILET PARTITION WALL (5'5" 5/8" GYP. BD. ON 2"x4" WOOD STUDS @ 16" O.C. W/4" SOUND INSULATION (TO BOTTOM OF ROOF TRUSSES (10'-4")
- A5 STORAGE PARTITION WALL (5'5" 1/2" GYP. BD. ON 2"x4" WOOD STUDS @ 16" O.C.
- A6 DEMISING WALL (5'5" 11 HOUR FIRE RATED UL-U305); 11 LAYER 5/8" FIRE RATED GYP. ON 2"x4" STUDS @ 16" O.C. W/4" BATT INSULATION W/VAPOR BARRIER. (OPTION: METAL STUDS - UL-U419)
- A7 EXTERIOR WALL FURRING (BY TENANT); 11 LAYER 5/8" GYPSUM BOARD ON VAPOR BARRIER ON 2"x2" WOOD FURRING W/ 1 1/2" RIGID WALL INSULATION (R7.5).
- A8 STAIR CONSTRUCTION: WOOD STAIR W/CLOSED RISER & 1 1/4" WOOD HANDRAIL. MOUNT 2'-10" ABOVE TREAD W/WALL BRACKETS (BLOCK SOLID). PROVIDE 1/2" GYP. BD. ON UNDERSIDE OF STAIR TO CLOSURE WALL UNDER STAIR. SEE BUILDING SECTION A/A6.
- A9 STAIR KNEE WALL (5'5" 1/2" GYP. BD. BOTH SIDES ON 2"x4" STUDS @ 16" O.C. 42" H. W/WOOD CAP FROM FLOOR TO LANDING. WALL TO LOFT FINISH FLOOR SHALL BE FULL HEIGHT. SEE BUILDING SECTION A/A6.
- A10 FIRE RATED ATTIC ACCESS PANEL - VERIFY/ COORDINATE LOCATION W/HVAC DUCTWORK.
- A11 APPROXIMATE LOCATION OF CEILING CLEARANCE OF 7'-0" W/CLOSURE WALL @ STAIR STRINGER.
- A12 EXTERIOR WALL FURRING (BY DEVELOPER); SAME AS NOTE A7
- A13 FIRE RATED ATTIC ACCESS PANEL (WALL TYPE)
- A14 5/8" GYPSUM BOARD ON ROOF TRUSS VERTICAL CHORD.
- A15 5/8" GYPSUM BOARD ON 2"x4" WOOD STUDS @ 16" O.C. CLOSURE WALL W/ 3 1/2" BATT INSULATION W/ VAPOR BARRIER
- A16 PLUMBING WALL: 5/8" WATER RESISTANT GYPSUM BOARD ON 2"x6" WOOD STUDS @ 16" O.C.
- A17 NOT USED
- A18 PROVIDE (2) LAYERS OF 5/8" FIRE RATED GYPSUM BOARD CEILING ON ROOF TRUSSES BOTTOM CHORD & SPRINKLER HEAD -AS DIRECTED BY BUILDING DEPARTMENT - VERIFY WITH FIRE DISTRICT.
- A19 4" ALUMINUM SIDING W/ CORNER BOARDS ON BUILDING PAPER ON 1/2" EXTERIOR PLYWOOD ON 2"x4" WOOD STUDS @ 16" O.C. (NOTE: PROVIDE INSULATION W/ VAPOR BARRIER @ REAR (TRUE) DORMERS.
- A20 TYPICAL FOR ALL FIRE RATED BARRIERS: PROVIDE FIRE DAMPERS @ DUCTWORK (SEE SHEET M1) & PENETRATIONS ARE TO BE SEALED W/ A FIRE SEALANT/COMPOUND EQUAL TO GE SILICONE OR DOW CORNING SEALANT/FOAM/COMPOUND, EQUAL TO UL1479 LABEL ACCORDING TO ASTM E814.

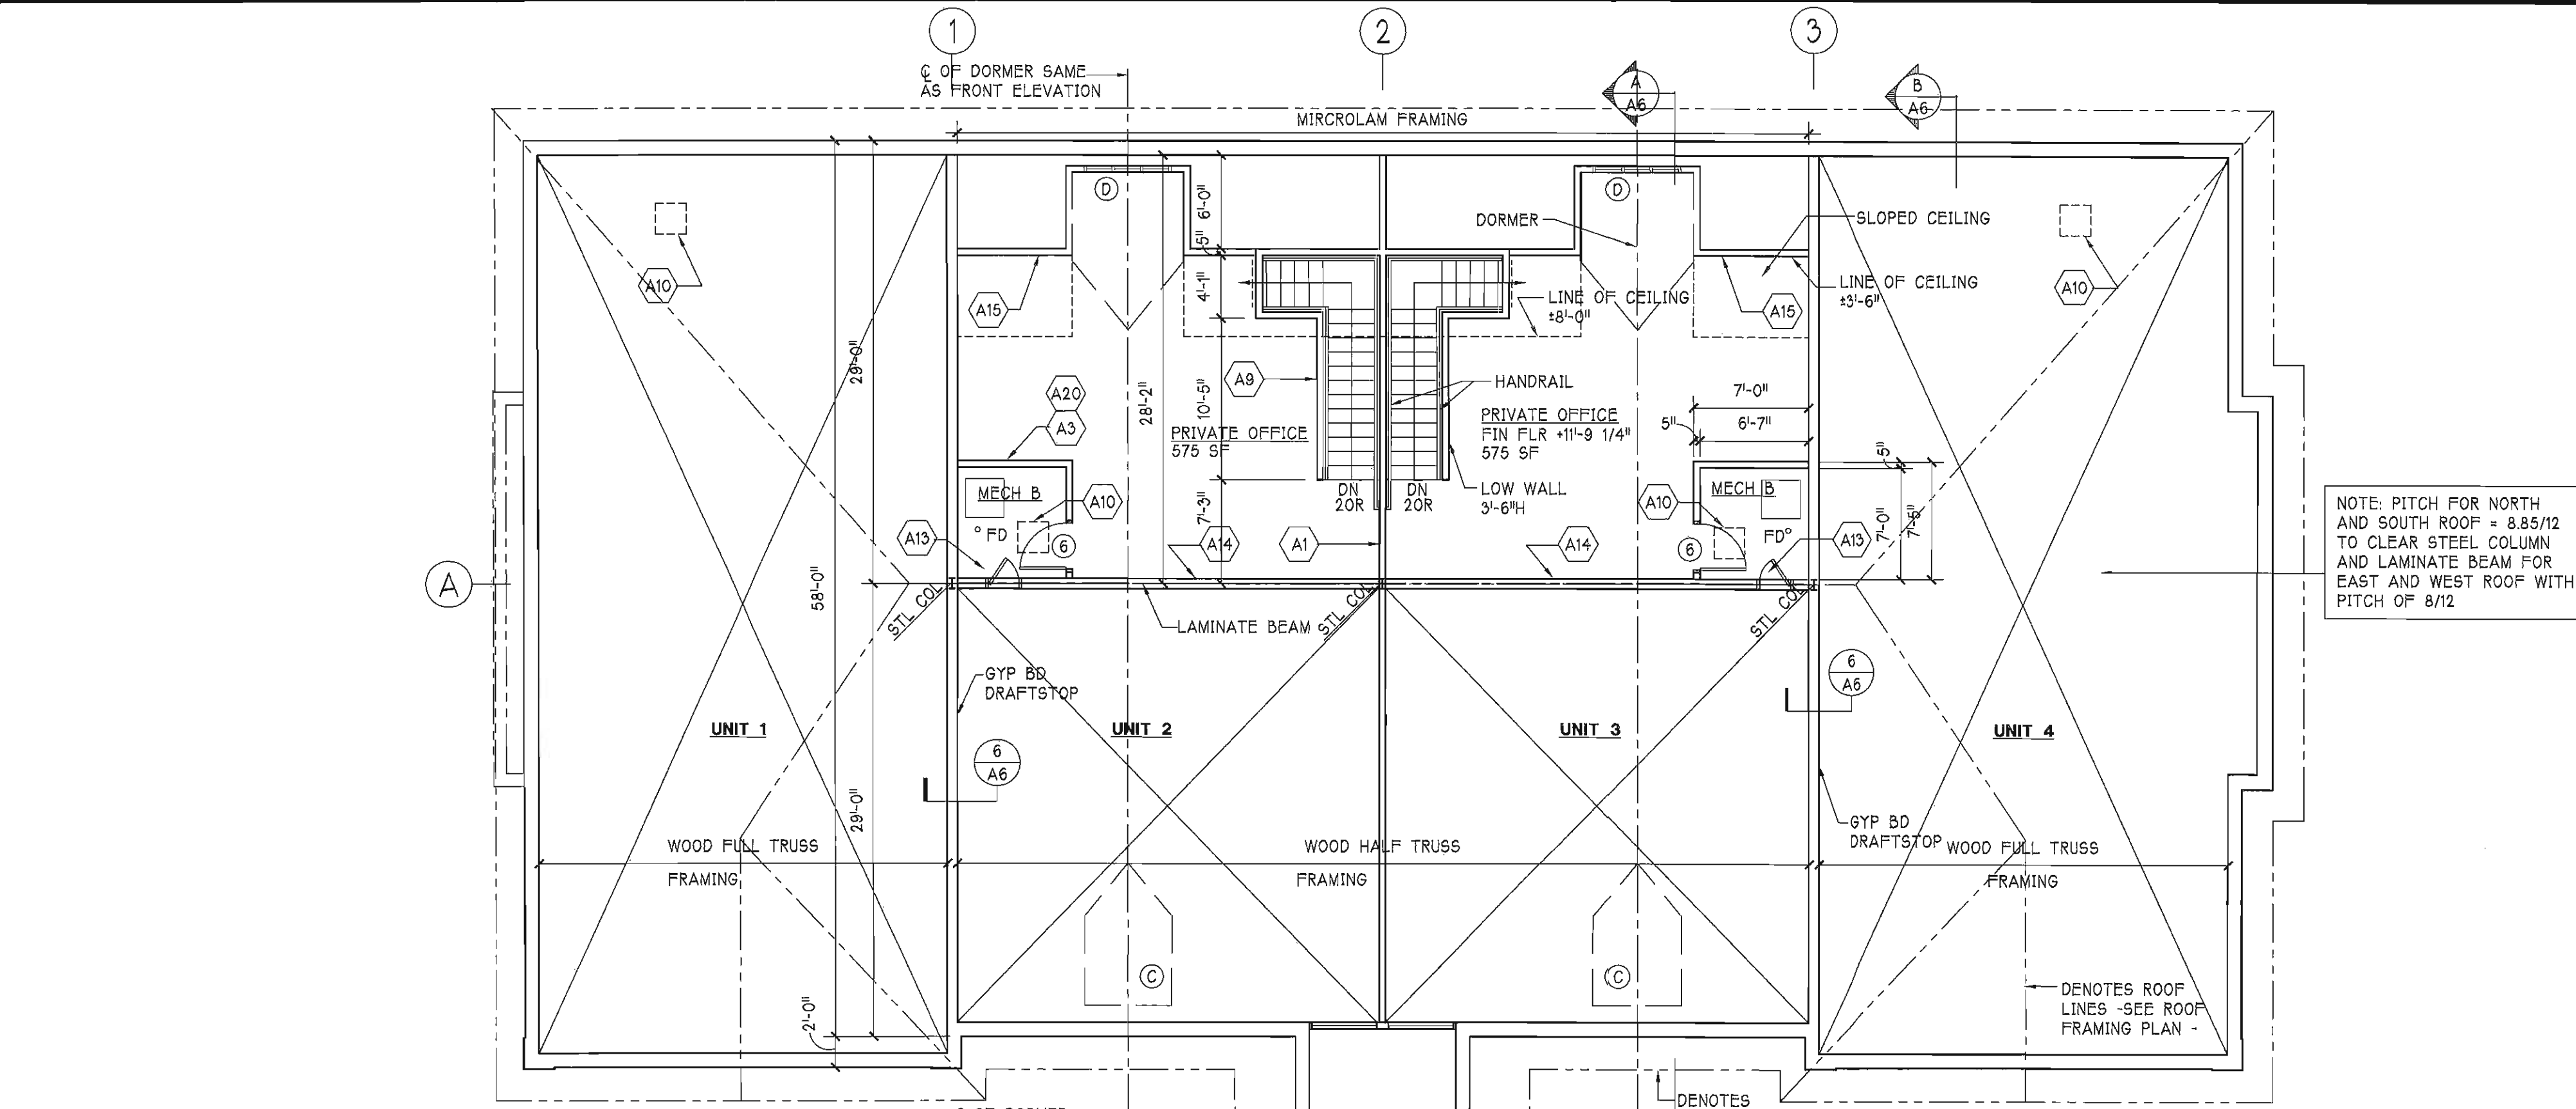

2 LOFT FLOOR PLAN

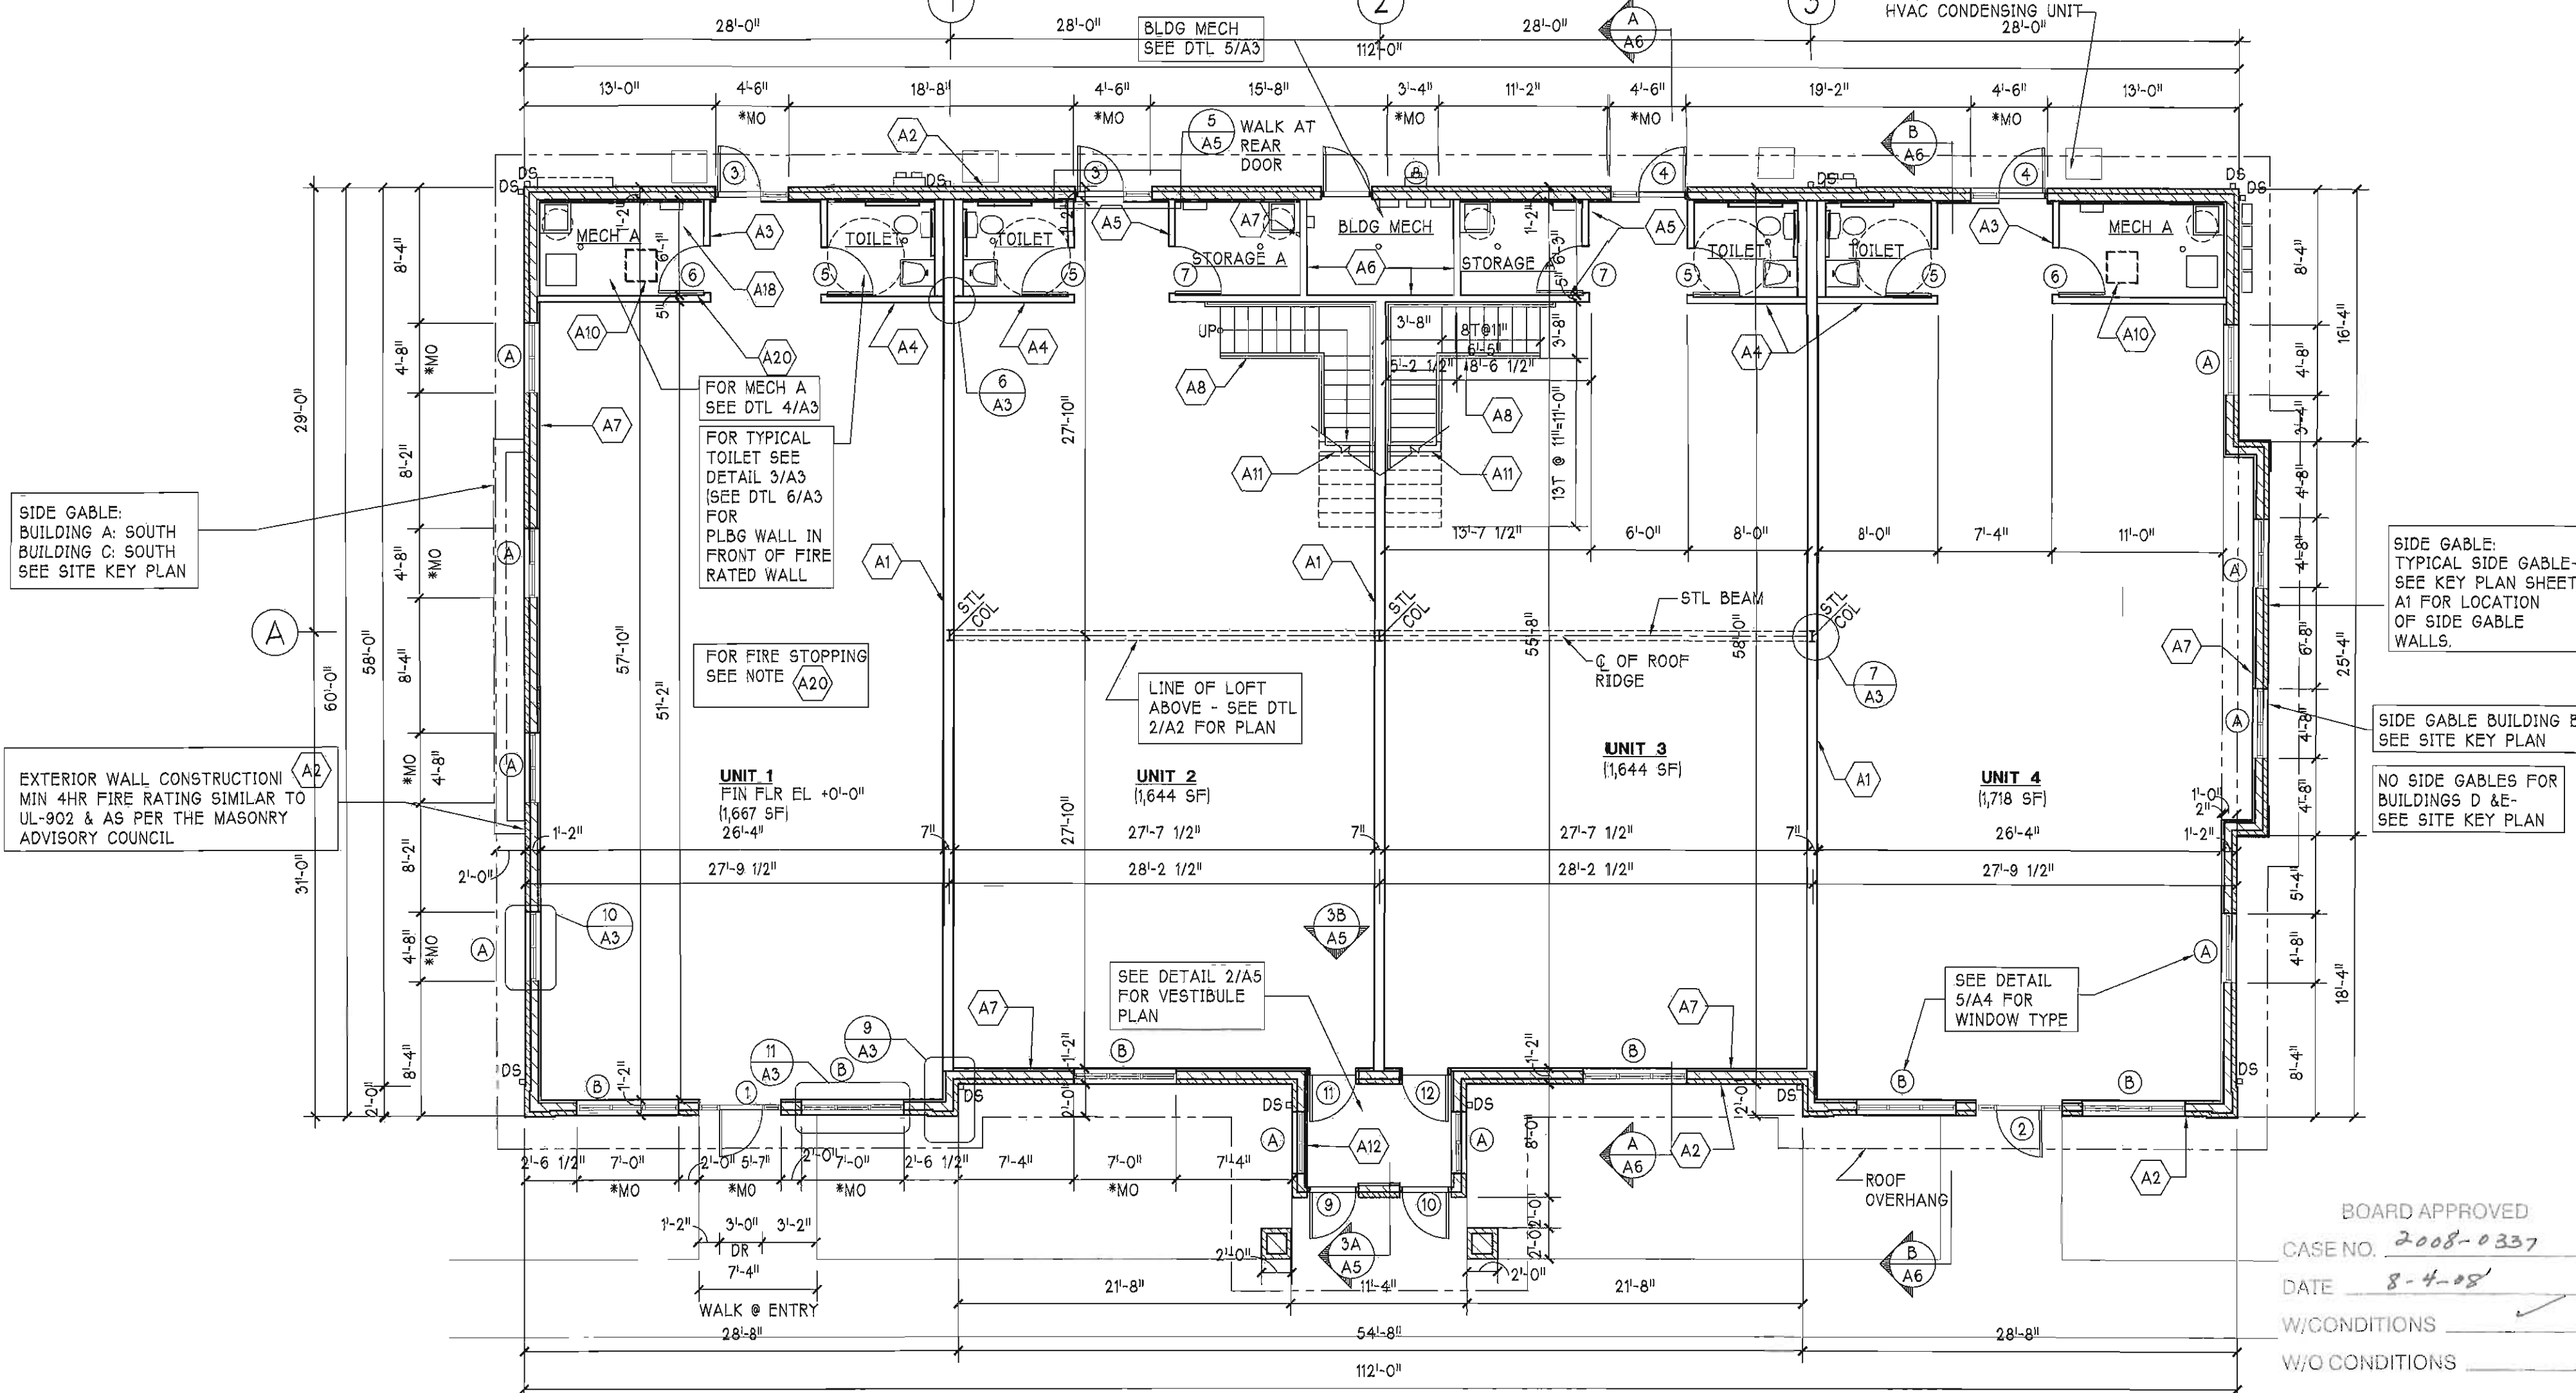

1 FIRST FLOOR PLAN

1/8" = 1'-0"

* M.O. - VERIFY MASONRY OPENING W/DOOR OR WINDOW MANUFACTURER

(SEE ADJACENT UNITS FOR TYPICAL NOTES & DIMENSIONS)

NORTH

VARIES -SEE SITE KEY PLAN SHEET A1 FOR ORIENTATION

CRAIG A. PODALAK ARCHITECTS
12410 S. NASHVILLE AVE.
PALOS HEIGHTS, IL 60463
708 / 389-3333

GLEN OAKS PHASE 5 OFFICE PARK
10640-10720 W 165TH STREET
ORLAND PARK, ILLINOIS

PROJECT NO. 0816
DATE 7-15-08

DRAWN BY RD
CHECKED BY CAP
FILE 0816A2

A2