

CENTER-STRUT® HEIGHT ADJUSTMENT SYSTEM ELECTRIC OPERATION With KEY SWITCH CONTROL FIELD WIRING DETAILS and REQUIREMENTS


NOTE - All wiring between the height adjuster and the key switch is to be done by an electrical contractor per the diagram below, to meet all local code requirements.

IMPORTANT NOTE - PERFORMANCE OF MOTOR IS BASED ON HAVING 115 VOLTS AT MOTOR TERMINALS. VOLTAGES LESS THAN 115 VOLTS WILL AFFECT HOISTING CAPACITY AND RESULT IN DAMAGE TO MOTOR THUS VOIDING WARRANTY. **SUBSTITUTION** OF THIS KEY SWITCH WILL VOID ALL WARRANTIES AND WILL RENDER THE OPERATION OF HEIGHT ADJUSTER UNSAFE.

CAUTION
KEY SWITCH MUST BE MOUNTED ON THE WALL IN A LOCATION SO THAT THE EQUIPMENT IT IS CONTROLLING IS IN FULL VIEW OF THE OPERATOR.

NOTE
ELECTRICAL CONTRACTOR TO PROVIDE FIELD WIRING AS REQUIRED TO MEET ALL LOCAL ELECTRICAL CODES.

TO JUNCTION BOX ON HEIGHT ADJUSTER FRAME

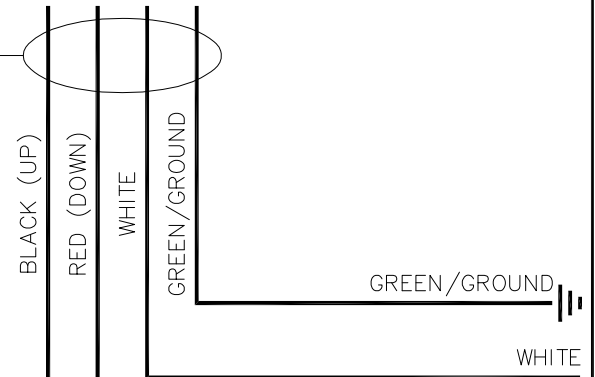

115 VOLT,
SINGLE PHASE
60 HERTZ
POWER SOURCE


HOT LINE

**** MINIMUM WIRE SIZE**
90' MAXIMUM RUN - 12 GA.
90' to 140' RUN - 10 GA.
OVER 140' RUN - 8 GA.

ELECTRICIAN NOTE - IF HEIGHT ADJUSTER OPERATION DOES NOT CORRESPOND TO UP and DOWN LABEL ON KEY SWITCH, REVERSE BLACK AND RED WIRES.

TOP VIEW OF KEY SWITCH

INDIVIDUAL KEY SWITCH MOUNTED IN A STANDARD 4-1/2" SQUARE FLUSH MOUNTED STAINLESS STEEL COVER PLATE FOR MOUNTING IN A 4" SQUARE x 3-1/2" DEEP MASONRY BOX (THEPITT No. 691 OR EQUAL) BY ELECTRICAL CONTRACTOR. KEY SWITCHES MAY BE GANGED IN ONE COVER PLATE - ONE FOR THE BACKSTOP, ONE FOR THE HEIGHT ADJUSTER. SEE TABLE BELOW FOR WALL BOX SIZE REQUIREMENTS - DIMENSION "A".

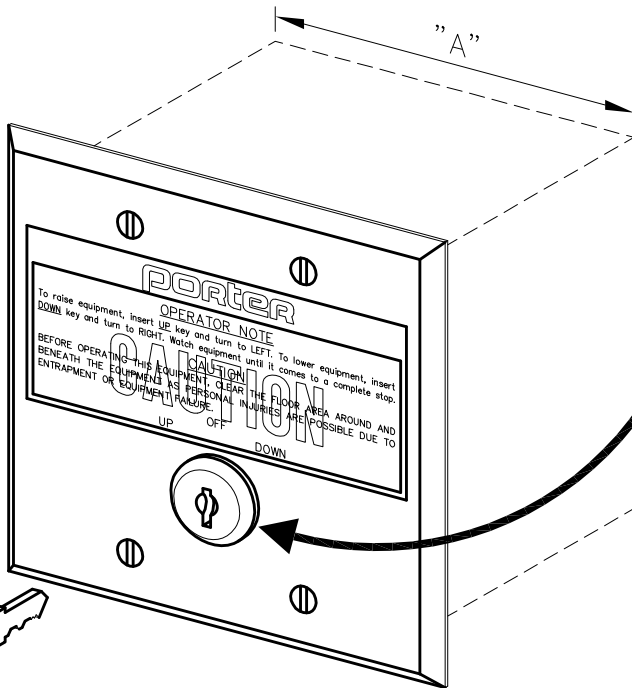

MOMENTARY KEY SWITCH FURNISHED WITH TWO KEYS (UP AND DOWN) TO PREVENT THE POSSIBILITY OF INSTANTANEOUS REVERSING OF THE MOTOR, WHICH COULD RESULT IN OVERRIDING LIMIT SWITCHES OR PLACING UNDUE STRESS ON THE HOIST SYSTEM. DO NOT SEPARATE THE KEYS FROM EACH OTHER.

| KEY SWITCH QTY. | "A" BOX WIDTH | THEPITT BOX No. (OR EQUAL) |
|-----------------|---------------|----------------------------|
| 1 | 3 3/4" | 691 |
| 2 | 7 3/8" | 693 |

| REVISION | DATE | Porter No. |
|----------|------|--------------|
| | | CUSTOMER No. |
| | | DATE |
| | | 10-1-2000 |

CENTER-STRUT® HEIGHT ADJUSTMENT SYSTEM - ELECTRIC OPERATION
With KEY SWITCH CONTROL
FIELD WIRING DETAILS and REQUIREMENTS

THIS PRINT IS THE PROPERTY OF PORTER ATHLETIC EQUIPMENT COMPANY AND MAY NOT BE REPRODUCED WITHOUT WRITTEN PERMISSION

porter
WORLD LEADER
IN QUALITY SPORTS EQUIPMENT
2500 S. 25th AVENUE
BROADVIEW, ILLINOIS 60155
www.porter-ath.com

DRAWING BY
RJM
CHECKED BY
EAS
PAGE No.
B-901-K